

Providing Intelligent User-Adapted Control Strategies in Building Environments

E. Sierra, R. García-Martínez, A. Hossian, P. Britos and E. Balbuena

Software & Knowledge Engineering Center. Graduate School. Buenos Aires Institute of Technology

Electrotecnic Department. School of Engineering. University of Comahue
Intelligent Systems Laboratory. School of Engineering. University of Buenos Aires

rgm@itba.edu.ar

Abstract. This article describes an intelligent system architecture that based on neural networks, expert systems and negotiating agents technologies is designed to optimize intelligent building's performance. By understanding a building as a dynamic entity capable of adapting itself not only to changing environmental conditions but also to occupant's living habits, high standards of comfort and user satisfaction can be achieved. Results are promising and encourage further research in the field of artificial intelligence applications in building automation systems.

1 Introduction

According to the latest definitions internationally accepted for an "intelligent building", this is a building highly adaptable to the changing conditions of its environment [Krainier, 1996]. But, in an overall concept of comfort, the idea of adaptation to changing environmental conditions may be not enough. Building systems are constructed in order to provide comfortable living conditions for the persons who live in them. It is well known that people usually differ in their personal perceptions of comfort conditions. To some extent, the sensation of comfort is an individual one and it is normally affected by cultural issues. Thus, the idea behind this research is to find techniques based on artificial intelligence in order to provide design recommendations for comfort systems in buildings so that these buildings can also be highly adaptable in terms of the comfort conditions desired by their users. In a few words, a building must "learn" to change its performance not only as a function of environmental conditions, but also as a consequence of preferences set by the people who live in it.

2 The Proposed Intelligent System Architecture

According to the latest trends in the field, intelligence in building systems tends to be distributed [So, 1999]. The proposed intelligent system architecture is shown in Figure 1. There is a main computer where the functions of monitoring, visualizing and recording parameters is carried out while the regulation functions are left to the local controllers located throughout the building [Wong, 2001]. These controllers are responsible for taking over local control tasks in the zone they serve. To accomplish its function, the centralized computer contains a database that keeps track of relevant information concerning building user's preferences. For instance, this database keeps records of time, date, number of persons in a room, current temperature and humidity values, as well as temperature and humidity values desired by users. In order to do this, temperature and humidity input panels are located in the different rooms. Each user can eventually set them to what he or she thinks is an ideal comfort condition. As comfort perception is an individual sensation, the database in the main computer keeps track of every individual requirement.

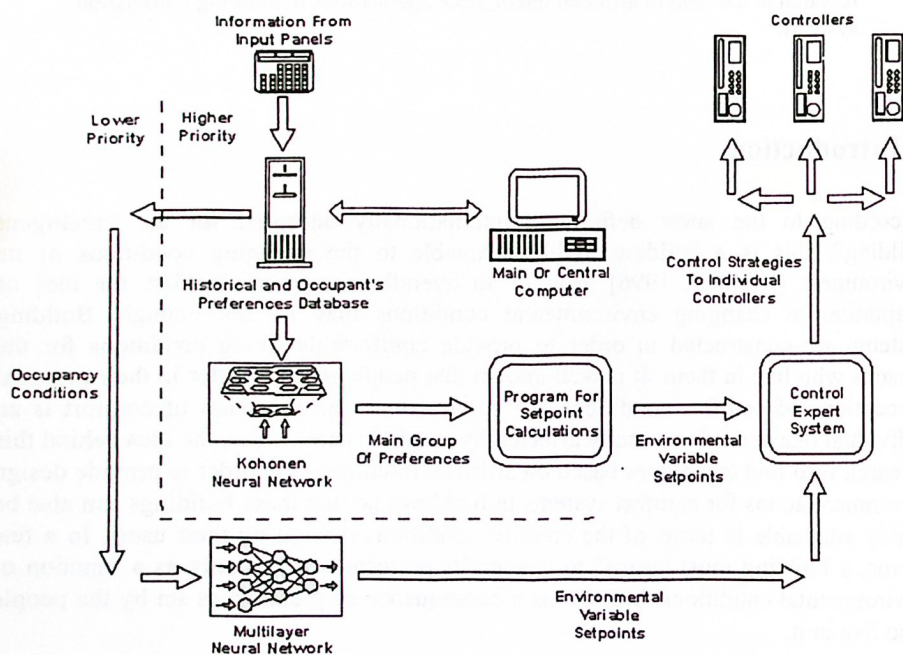


Fig. 1. Intelligent System Architecture

The information contained in the user's requirements database for a given room is applied to a neural network of the self organizational maps of Kohonen (SOM) [Rich & Knight, 1991; Hiler & Martinez, 1995] type, which is used to cluster all the user's requirements and discard all those groups of requirements which are not relevant in terms of their approximation to the main cluster of preferences. Once a unique group of requirements is selected, their values are applied as input to a program which

provides the limits as well as the average value for a particular environmental variable. This value is used as reference or set-point for the local control strategies set by an expert system which runs on the main computer. This expert system takes decisions concerning control strategies which are used to activate, deactivate or tune the individual controllers. The information about relevant occupancy and setting conditions, as well as the final values of environmental variables is used to train a multi-layer neural network which outcomes will provide ideal environmental values in case of absence of occupants or of preference information given by them. In any case, set-points assigned to comfort variables provided by the analysis of user's desired environmental conditions is given priority over any automatic calculation of these conditions.

3 Energy Saving Conditions

A very important issue in intelligent buildings technology is related to energy saving policies [Sierra *et al*, 2004]. Optimization procedures carried out to cut off energy consumption rates are not only justified in terms of operation costs reduction but also because of the environmental benefits implied in the adoption of energy saving strategies.

In order to accomplish previously mentioned optimization procedures, an expert system [García-Martínez & Britos, 2004] containing rules that perform energy saving strategies is set up in the central computer. However, it is necessary to verify if the rules defined in the energy saving expert system may eventually alter the comfort conditions established by the control strategy expert system. As it is shown on Figure 2, there is an intelligent negotiation agent [Allen *et al.*, 1991; Conry *et al.*, 1988; Ferber & Drougou, 1992] which runs in the central computer created to determine whether the application of energy saving strategies will: a) not affect current comfort conditions in a given space (not affected) b) affect current comfort conditions but within the limits found by the SOM neural network based upon preference information provided by occupants (partially affected) c) affect current comfort conditions beyond the limits set by occupant's requirements (fully affected).

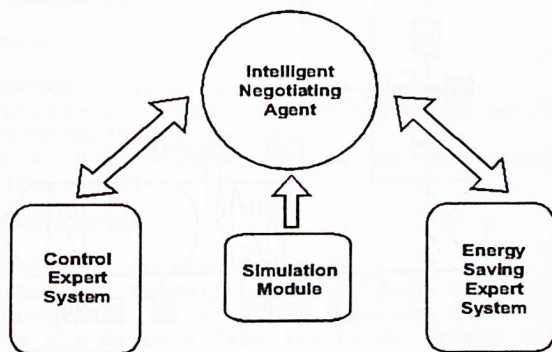


Fig. 2. Negotiation Control and Energy Saving Rules

The policy applied by the intelligent negotiation agent in the different situations mentioned earlier can be summarized as follows:

- If comfort conditions are not affected, rules defining energy saving strategies are given the highest priority
- If comfort conditions are partially affected, rules defining energy saving strategies are given an intermediate priority, just lower than the priority given to the rules that regulate the operation of main control actuators.
- If comfort conditions are fully affected, rules defining energy saving strategies are given the lowest priority.

- b) If comfort conditions are partially affected, rules defining energy saving strategies are given an intermediate priority, just lower than the priority given to the rules that regulate the operation of main control actuators.

- c) If comfort conditions are fully affected, rules defining energy saving strategies are given the lowest priority.

After the previously described negotiation policy has been applied, the control expert system located in the main central computer has an updated rule base which can be used to set up the operation mode of local controllers (on, off, normal) and tune them accordingly, for example, by determining the appropriate set-point for the control variable.

4 An Example

With the purpose of providing an example that illustrates the functionality of the proposed intelligent system, the operation of the air – handling system depicted in Figure 3 will be described. It is assumed that the HVAC engineer has already designed the air handler in terms of laying out the ductwork, appropriately sizing the fan and heating and cooling coils, and selecting the proper dampers, damper actuators and motor contactor [ASHRAE, 1998; CSI, 1988]. From this design a system diagram has been constructed as shown in Figure 3.

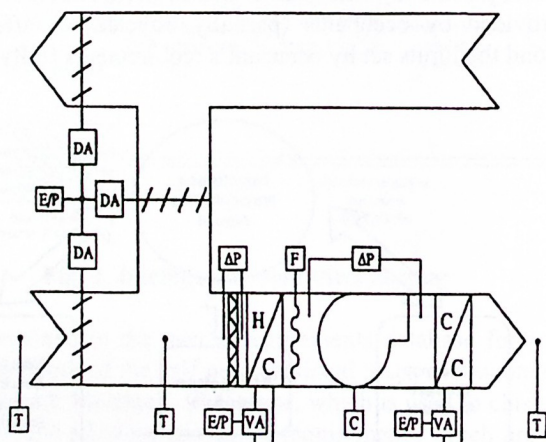


Fig. 3. System Diagram for the Air Handler

The designations DA and VA stand for damper and valve actuators, respectively, C is for electrical contactor and H/C and C/C represent the heating and cooling coils. When building zone building served by the air-handler is "occupied", i.e., the current date and time fall within a certain schedule, the system is said to be in occupied mode. In this mode, the fan is started and the heating and cooling valves and dampers are modulated so as to maintain the set-point temperature in the zone. This is called the "normal" operating condition. Control strategies describe how specific subsystems are to be controlled [IEEE, 1980; NISTIR, 1991]. Thus, some of the rules contained in the rule base of the control expert system will stated as follows:

```

IF    the date and time fall within the specified schedule
THEN  the system shall enter the occupied mode.

IF    the system is in the occupied mode,
THEN  the supply fan shall be turned on,
AND   the normally closed cooling valves and air dampers shall
      be controlled by a sequenced PI (Proportional plus
      Integral) controller to maintain the room air
      temperature set-point to 70 °F.

IF    the date and time fall outside of the specified schedule
AND   the room air temperature exceeds 55 °F
THEN  the system shall enter the unoccupied mode.

IF    the system is in the unoccupied mode
THEN  the supply fan shall be turned off, the heating valve
      shall be set to fully open and the cooling valve and
      outside air dampers shall be set to fully closed.

IF    the date and time fall outside of the specified schedule
AND   the room air temperature is less than or equal to 55 °F,
THEN  the system shall enter setback mode.

IF    the system is in the setback mode,
THEN  the system will remain in this mode until the room air
      temperature exceeds 60 °F.

```

Energy saving strategies were designed in order to diminish energy consumption levels while keeping a satisfying response to the building energy demand profiles. Therefore, some of the rules contained in the rule base of the energy saving expert system can be enunciated in the following manner:

Dry Bulb Economizer Control:

```

IF    the system is in occupied mode
AND   the outside air temperature rises above 65 °F, the dry
      bulb economizer set-point
THEN  the outside air damper will be set to a constant
      position of 20%.

```

Mixed Air Low Limit Control:

```

IF    the system is in occupied mode
AND   the mixed air temperature drops from 40 to 30 °F,
THEN  a proportional (P) control algorithm shall modulate the
      outside air dampers from 100 to 0%. Mixed air low limit
      control shall have priority over dry bulb economizer
      control.

```

Free cooling:

```

IF      the system is in unoccupied mode AND the room air
        temperature exceeds 65 °F
AND     the outside air temperature equals to or is less than 55
        °F,
THEN    the supply fan shall be turned on the heating and
        cooling valves shall be set to fully closed and the
        outside air dampers shall be set to fully open.

```

It is clear that the set-points specified in the previous rules are variables subject to values set by the output of the program which receives as input the outcome of a Kohonen's neural network classifier, as it was stated in section 2, when describing the overall intelligent system architecture. Thus, the system tries to capture the occupants' preferences by modifying the set-points of control variables to users' demands. These new values for set-points are inserted in the rules that perform the control and energy saving strategies of the whole building. These are precisely the rules contained in the expert system that are running in the central computer.

5 Implementation and Results

A prototype of the proposed intelligent system has been implemented in CLIPS, a tool for developing expert systems. Neural network and negotiating agent algorithms have been programmed in C++. The system prototype has been tested in the building of the Ministry of Education, located in the city of Neuquén, Argentina. This building has been designed with a high degree of intelligence. However, its orientation, solar gain controls, surrounding vegetation and other important environmental aspects seem not to have been seriously taken into account in the building's design process. As a result of this, its users show high standards of discomfort, mainly due to the fact that the building is not properly integrated to its surrounding environment. In this scenario, the intelligent software tool proposed in this paper was seen as a starting point for a solution to the building environmental problems. After almost a year of continuous tuning and adjusting procedures, the most updated prototype of the system was put to work. The people who work in this public building was strongly encouraged to set comfort parameters in the input control panels that were installed for this purpose in different building zones. Light, temperature, humidity, safety and energy saving control strategies were supported by the intelligent system located in the building area for environmental control. The comments of users who admitted positive changes in comfort conditions were confirmed by a survey. The survey outcomes were: 75 % percent of users were very satisfied with the performance of the new system, 20 % were just satisfied and 5% not satisfied. Such results encourage advancing in this direction of optimizing the operative and control strategies carried out by the developed system.

6 Conclusions

Techniques of artificial intelligence have been used in many decision, control and automation systems in the last twenty years. Building systems have not been an exception. In this direction, the intelligent system that is proposed in this article tries to contribute in the field of intelligent buildings optimization, by transforming them in a dynamic space, with high standards of comfort and occupant's satisfaction. In this sense, the ability inherent to intelligent systems that are capable of learning from their own environment plays a very important role in the achievement of these building performance optimization goals. Furthermore, results obtained as a consequence of the proposed system implementation are very encouraging. Thus, further research and development work in the field deserves particular attention.

References

1. Krainier, A. 1996. *Toward smart buildings*, Architectural Assn. Graduate School, Environment & Energy Studies Program.
2. So, A. 1999. *Intelligent building systems*, Kluwer Academic Press
3. Wong, K. 2001. *The Intelligent Building Index : ibi manual : version 2.0*, Hong Kong: Asian Institute of Intelligent Buildings
4. Rich Edward and Knight Kevin (1991) *Introduction to Artificial Networks*. Mac Graw-Hill. Publications
5. Hilera J. and Martínez V. 1995. *Redes Neuronales Artificiales. Fundamentos, modelos y aplicaciones*. RA-MA, Madrid
6. Sierra, E., Hossian, A., Labriola, C., García Martínez R. 2004. *Optimal Design of Constructions: A Preliminary Model*. Proceedings of the World Renewable Energy Congress (WREC 2004) – Denver, Colorado, Estados Unidos
7. García Martínez, R. and Britos, P. 2004. *Ingeniería de Sistemas Expertos*. Editorial Nueva Librería. 649 páginas. ISBN 987-1104-15-4
8. Allen, J. F, Kautz, H., Pelavin, R. N., and Tenenber, J.D., 1991. Reasoning About Plans. Morgan Kaufmann Publishers, Inc. San Mateo, California
9. Conry S. E., Meyer R. A., and Lesser V.R., 1988. *Multistage negotiation in distributed planning*. En Bond A and Gasser, L. [Eds] Readings in Distributed Artificial Intelligence. Morgan Kaufmann Publishers, Inc. San Mateo, California
10. Ferber J. and Drougol A., 1992. Using reactive multiagent systems in simulation and problem solving. In Avouris, N.M and Gasser L. [Eds], *Distributed Artificial Intelligence: Theory and Praxis*. Kluwer Academic Press.
11. ASHRAE. 1989. ASHRAE Guideline 1-1989, *Guideline for Commissioning of HVAC Systems*, Atlanta, ASHARE, 1989.
12. CSI.1988. *CSI Manual of Practice*, Alexandria, VA: The Construction Specification Institute.
13. IEEE. 1980. Standard 587-80, *Guide for Surge Voltage in Low Voltage AC Power Circuits*. IEEE. New York.
14. NISTIR. 1991. NISTIR 4606, *Guide Specification for Direct Digital Control Based Building Automation System*, Available from the National Technical Information Service. Springfield. VA 22161.